


# 1000 Gallon (Aboveground Installation Guide)

All cylinders must be set on solid concrete slabs and lintels!!


Before positioning slabs, place landscape fabric or similar product to prevent weeds growing against the cylinder.

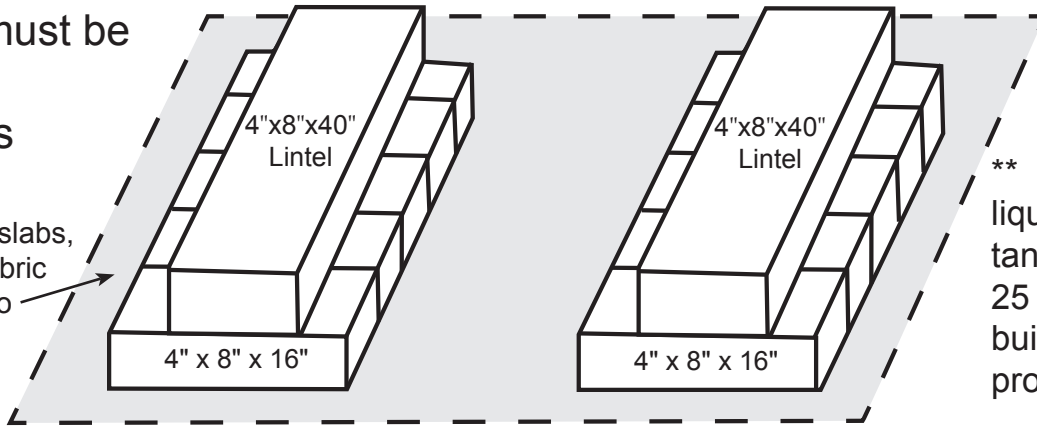

\*\* If transferring liquid propane, tanks must be 25 ft. from buildings and property lines.

## Location of ASME Containers From NFPA 58, Appendix I

Federal, state, and local ordinances and regulations should be observed at all times.

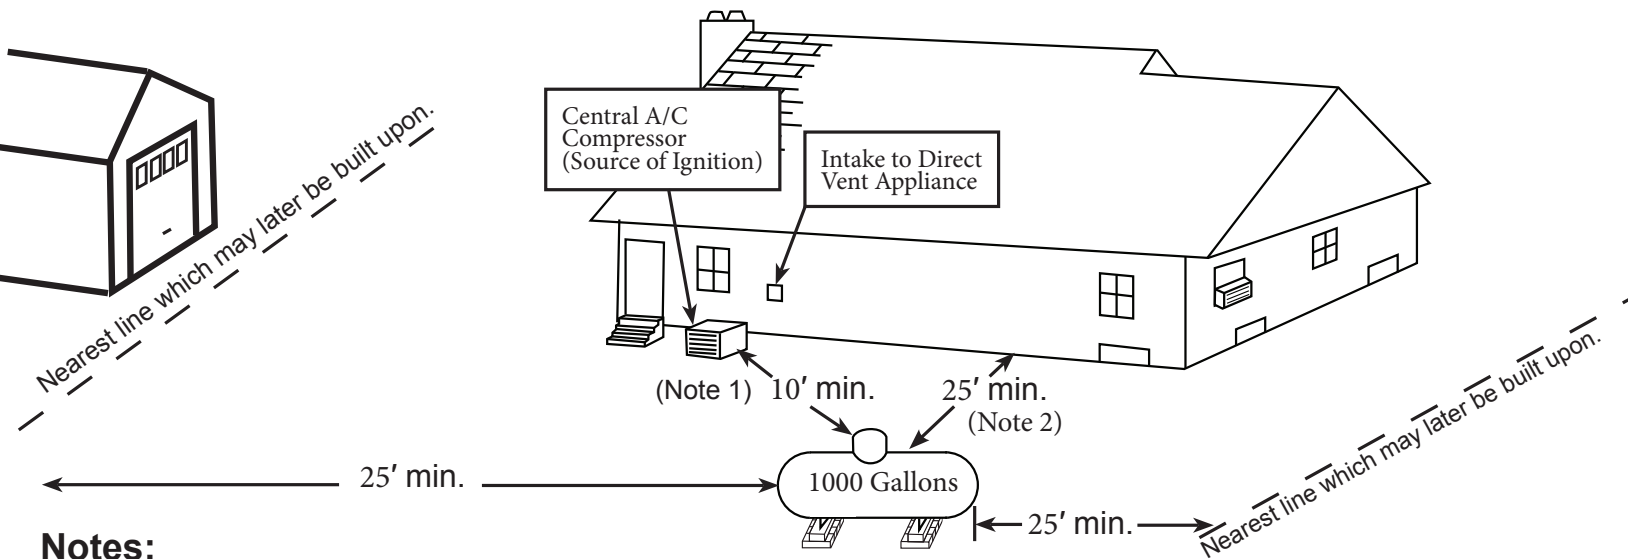

### Notes:

- 1) Regardless of its size, any ASME tank filled on-site must be located so that the filling connection and fixed liquid level gauge are at least 10 feet from external source of ignition (i.e. open flame, window A/C, compressor, etc), intake to direct vented gas appliance or intake to a mechanical ventilation system.
- 2) May be reduced to 10 feet minimum for a single container of 1200 gallons water capacity or less if it is located at least 25 feet from any other LP-Gas container of more than 125 gallons water capacity.
- 3) Where the container may be subject to abrasive action or physical damage due to vehicular traffic or other causes, it must be protected against such physical damage.


These instructions are intended only for a basic installation guide. Always refer to federal, state, and local ordinances and regulations or NFPA 58. 11-15

1000 Gallon Tank .....	\$ _____
Blocking .....	\$ _____
Regulators & Fittings.....	\$ _____
1/2" Yellow Coated.....	\$ _____
Copper Tubing	\$ _____
(50-100-150 ft. Coils)	
<b>Total \$</b> _____	



Phone: 717.354.5691  
 676 N. Shirk Road — New Holland, PA 17557  
 Hours: Mon. thru Fri. 7a.m. - 5p.m. Sat. 7-11:30 a.m.

# 1000 Gallon (Aboveground Installation Guide)

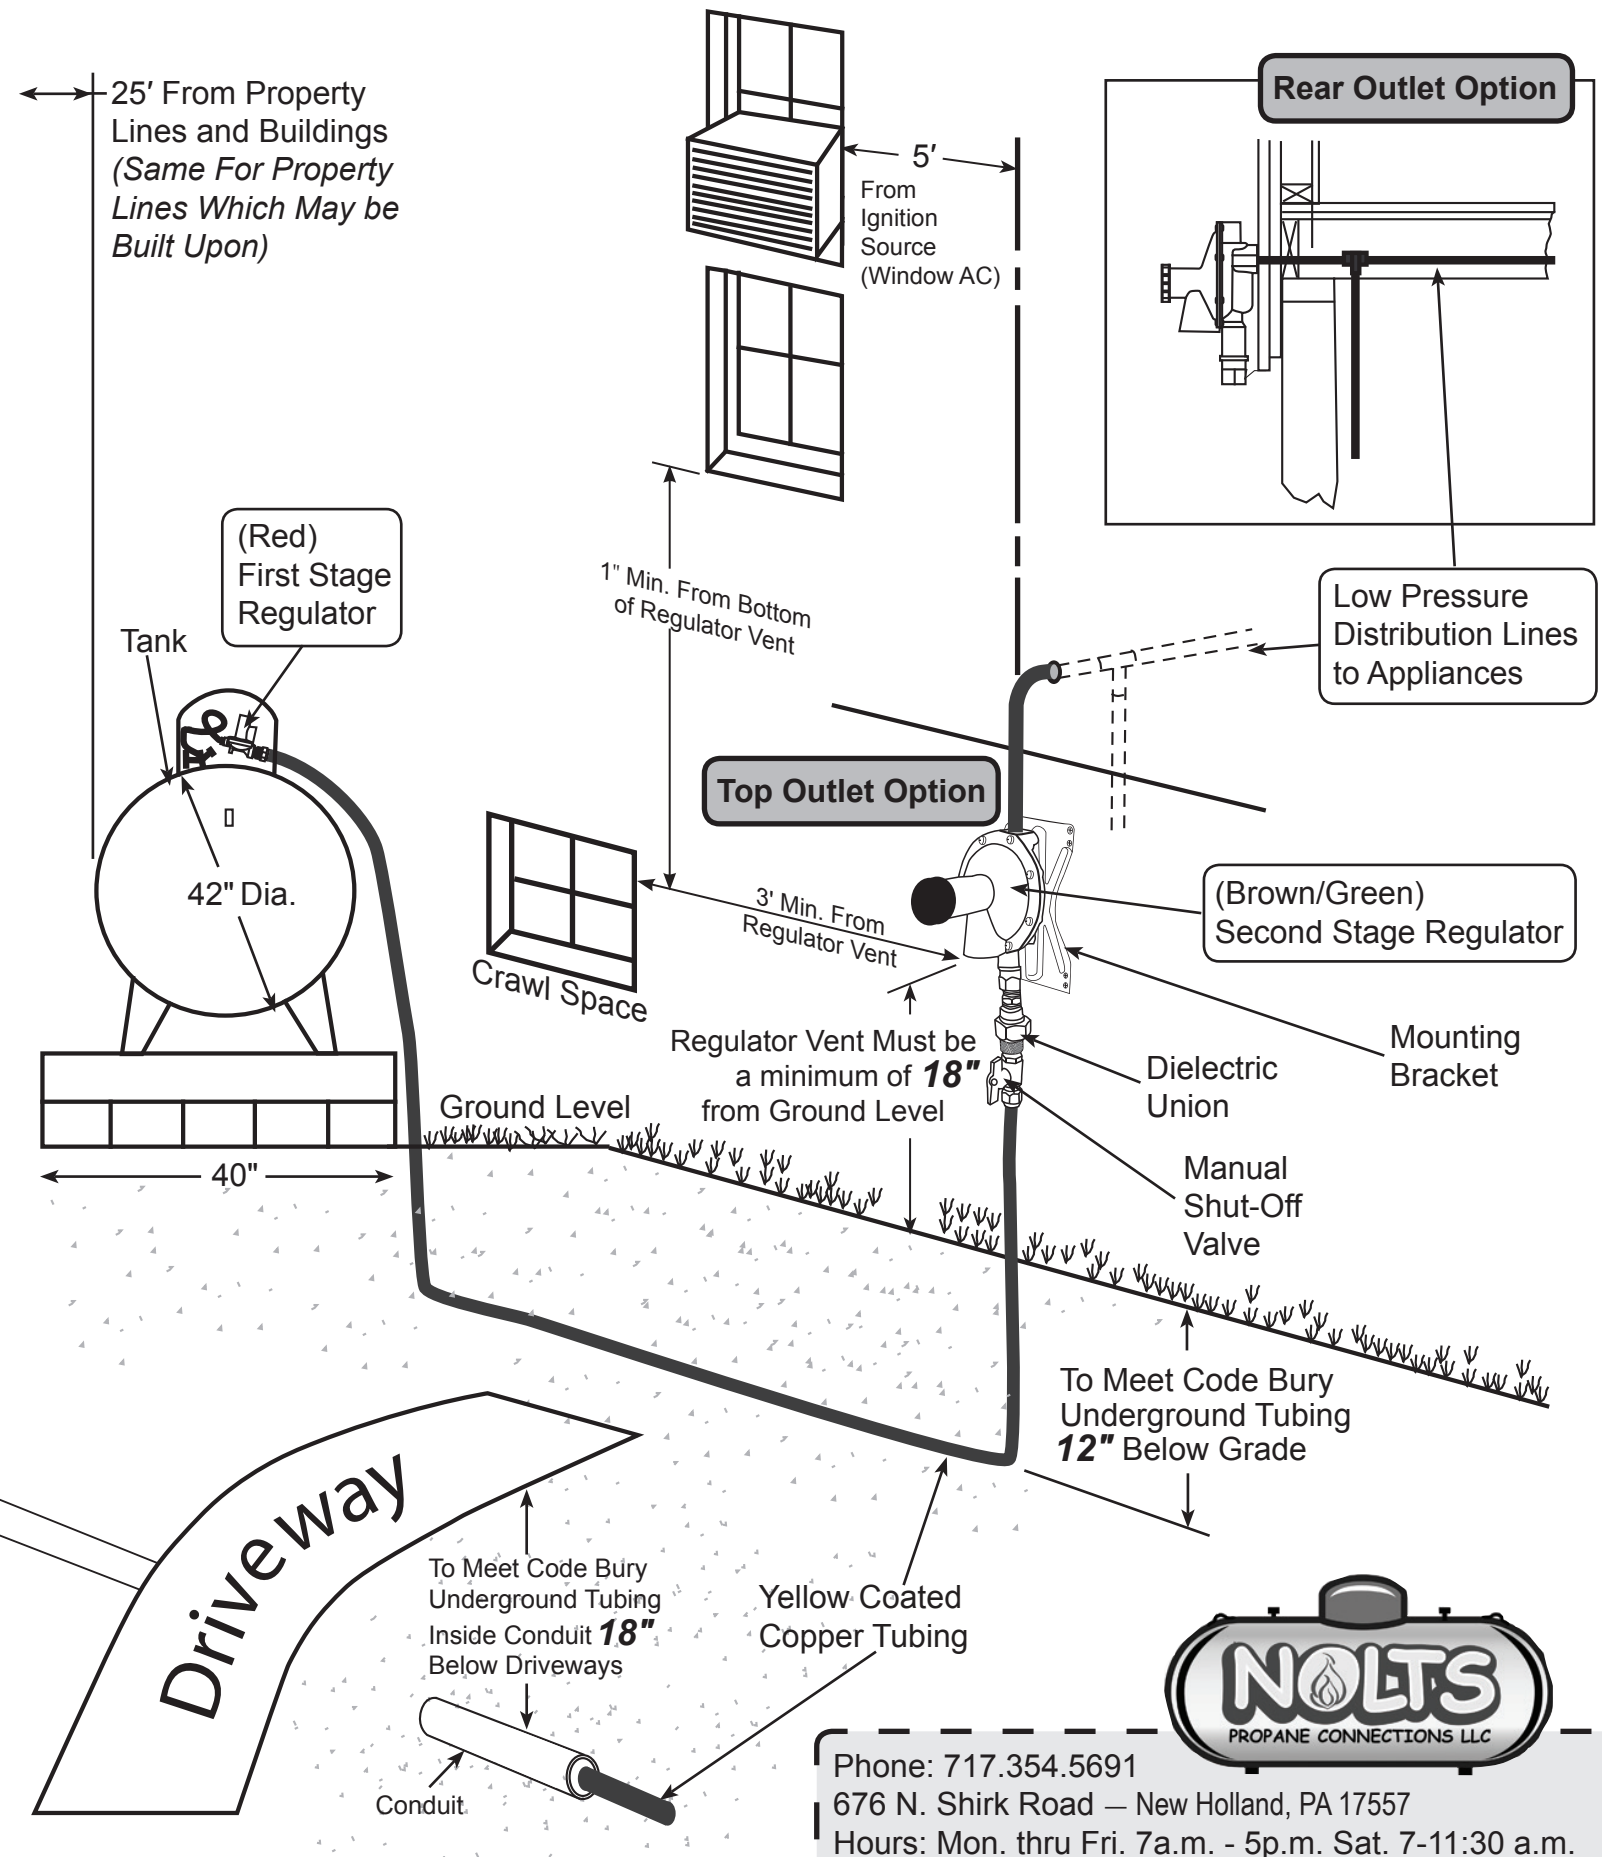

Phone: 717.354.5691

676 N. Shirk Road — New Holland, PA 17557

Hours: Mon. thru Fri. 7a.m. - 5p.m. Sat. 7-11:30 a.m.